

Experiment Number: 96014-02
Test Type: 14-DAY
Species/Strain: Mouse/B6C3F1

E03: TDMS CAMERA-READY GROWTH CURVE
Test Compound: Water disinfection byproducts (Bromodichloroacetic acid)
CAS Number: 71133-14-7

Date Report Requested: 10/22/2014
Time Report Requested: 05:07:39
First Dose M/F: NA / NA
Lab: SRI

C Number: C96014
Lock Date: Not Entered.
Cage Range: All
Date Range: All
Reasons For Removal: All
Removal Date Range: All
Treatment Groups: All
Study Gender: Both
PWG Approval Date NONE

Experiment Number: 96014-02

Test Type: 14-DAY

Species/Strain: Mouse/B6C3F1

E03: TDMS CAMERA-READY GROWTH CURVE

Test Compound: Water disinfection byproducts (Bromodichloroacetic acid)

CAS Number: 71133-14-7


Date Report Requested: 10/22/2014

Time Report Requested: 05:07:39

First Dose M/F: NA / NA

Lab: SRI

MALE

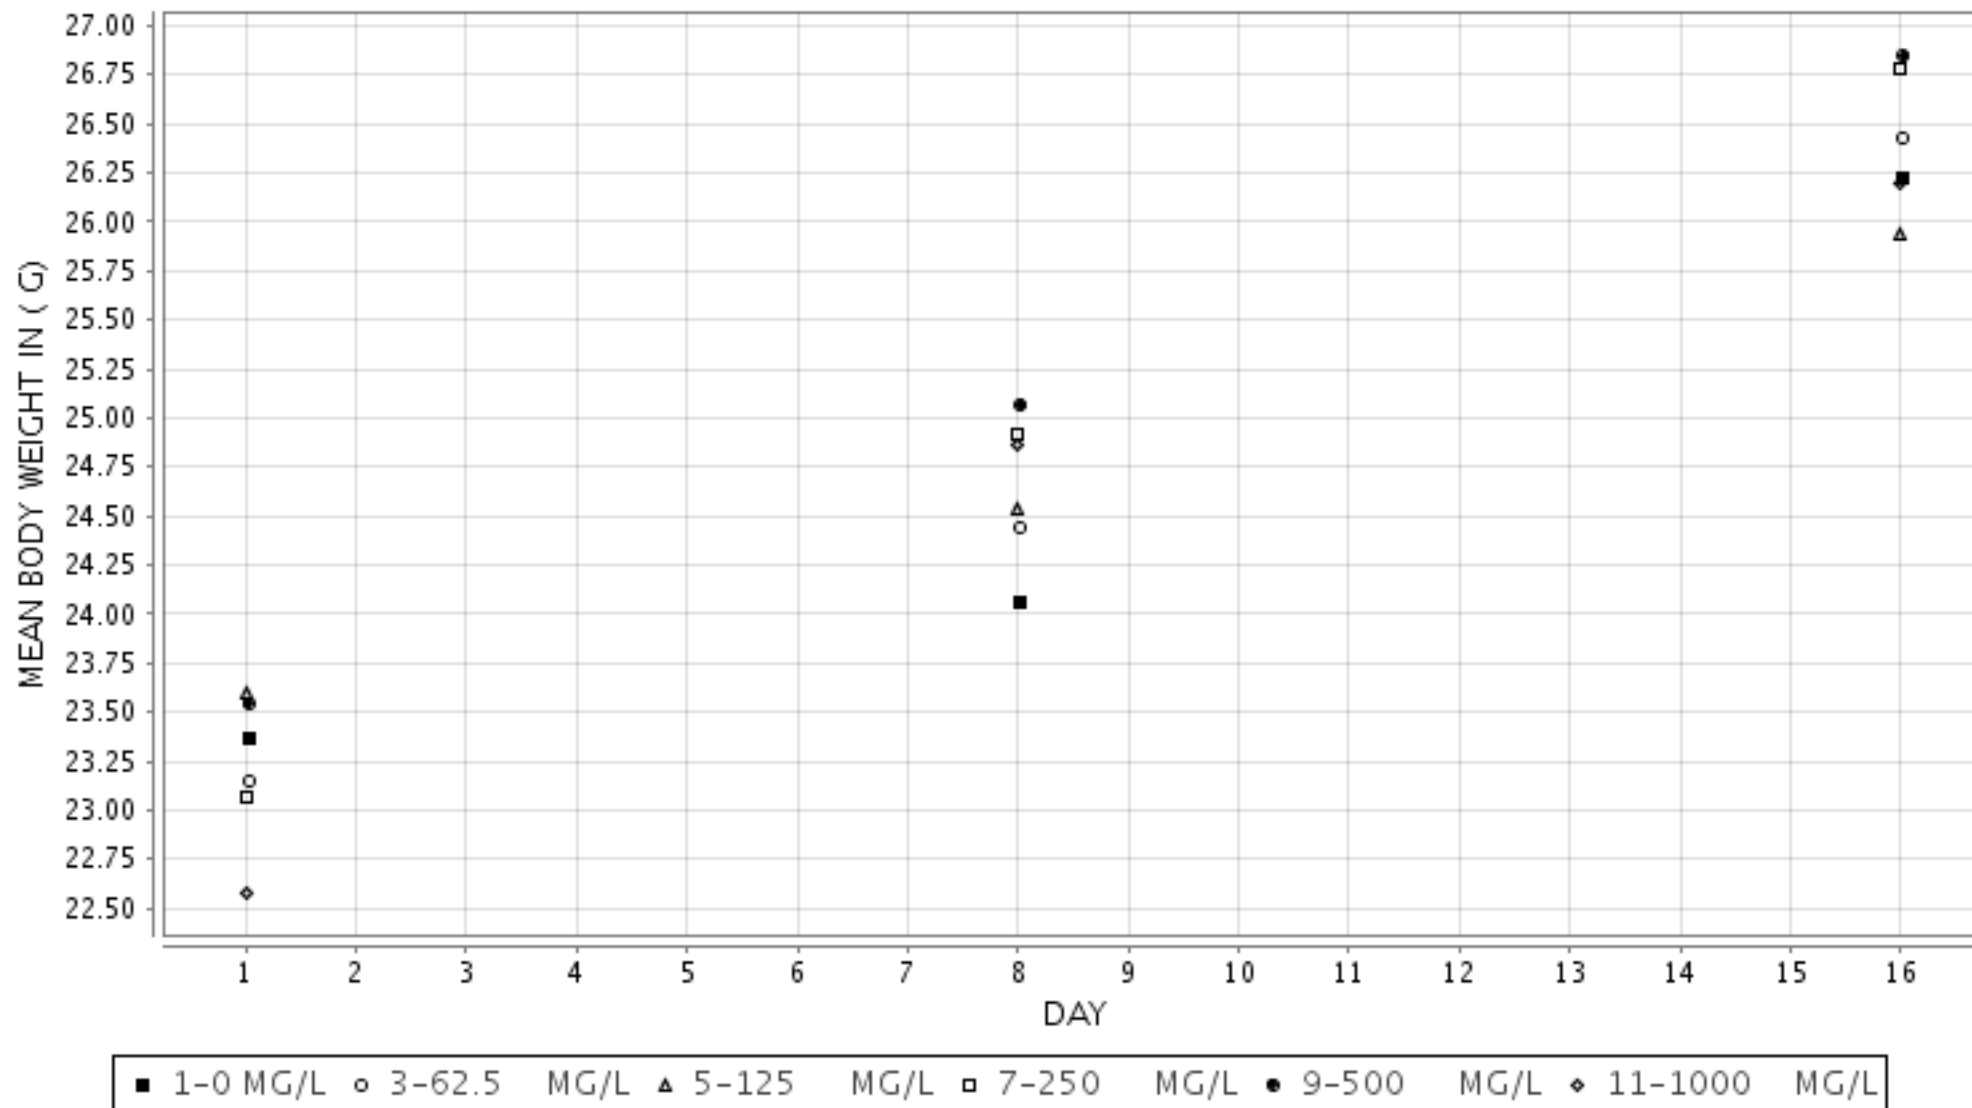

Experiment Number: 96014-02

Test Type: 14-DAY

Species/Strain: Mouse/B6C3F1

E03: TDMS CAMERA-READY GROWTH CURVE

Test Compound: Water disinfection byproducts (Bromodichloroacetic acid)

CAS Number: 71133-14-7

Date Report Requested: 10/22/2014

Time Report Requested: 05:07:39

First Dose M/F: NA / NA

Lab: SRI

END OF MALE DATA

Experiment Number: 96014-02

Test Type: 14-DAY

Species/Strain: Mouse/B6C3F1

E03: TDMS CAMERA-READY GROWTH CURVE

Test Compound: Water disinfection byproducts (Bromodichloroacetic acid)


CAS Number: 71133-14-7

Date Report Requested: 10/22/2014

Time Report Requested: 05:07:39

First Dose M/F: NA / NA

Lab: SRI

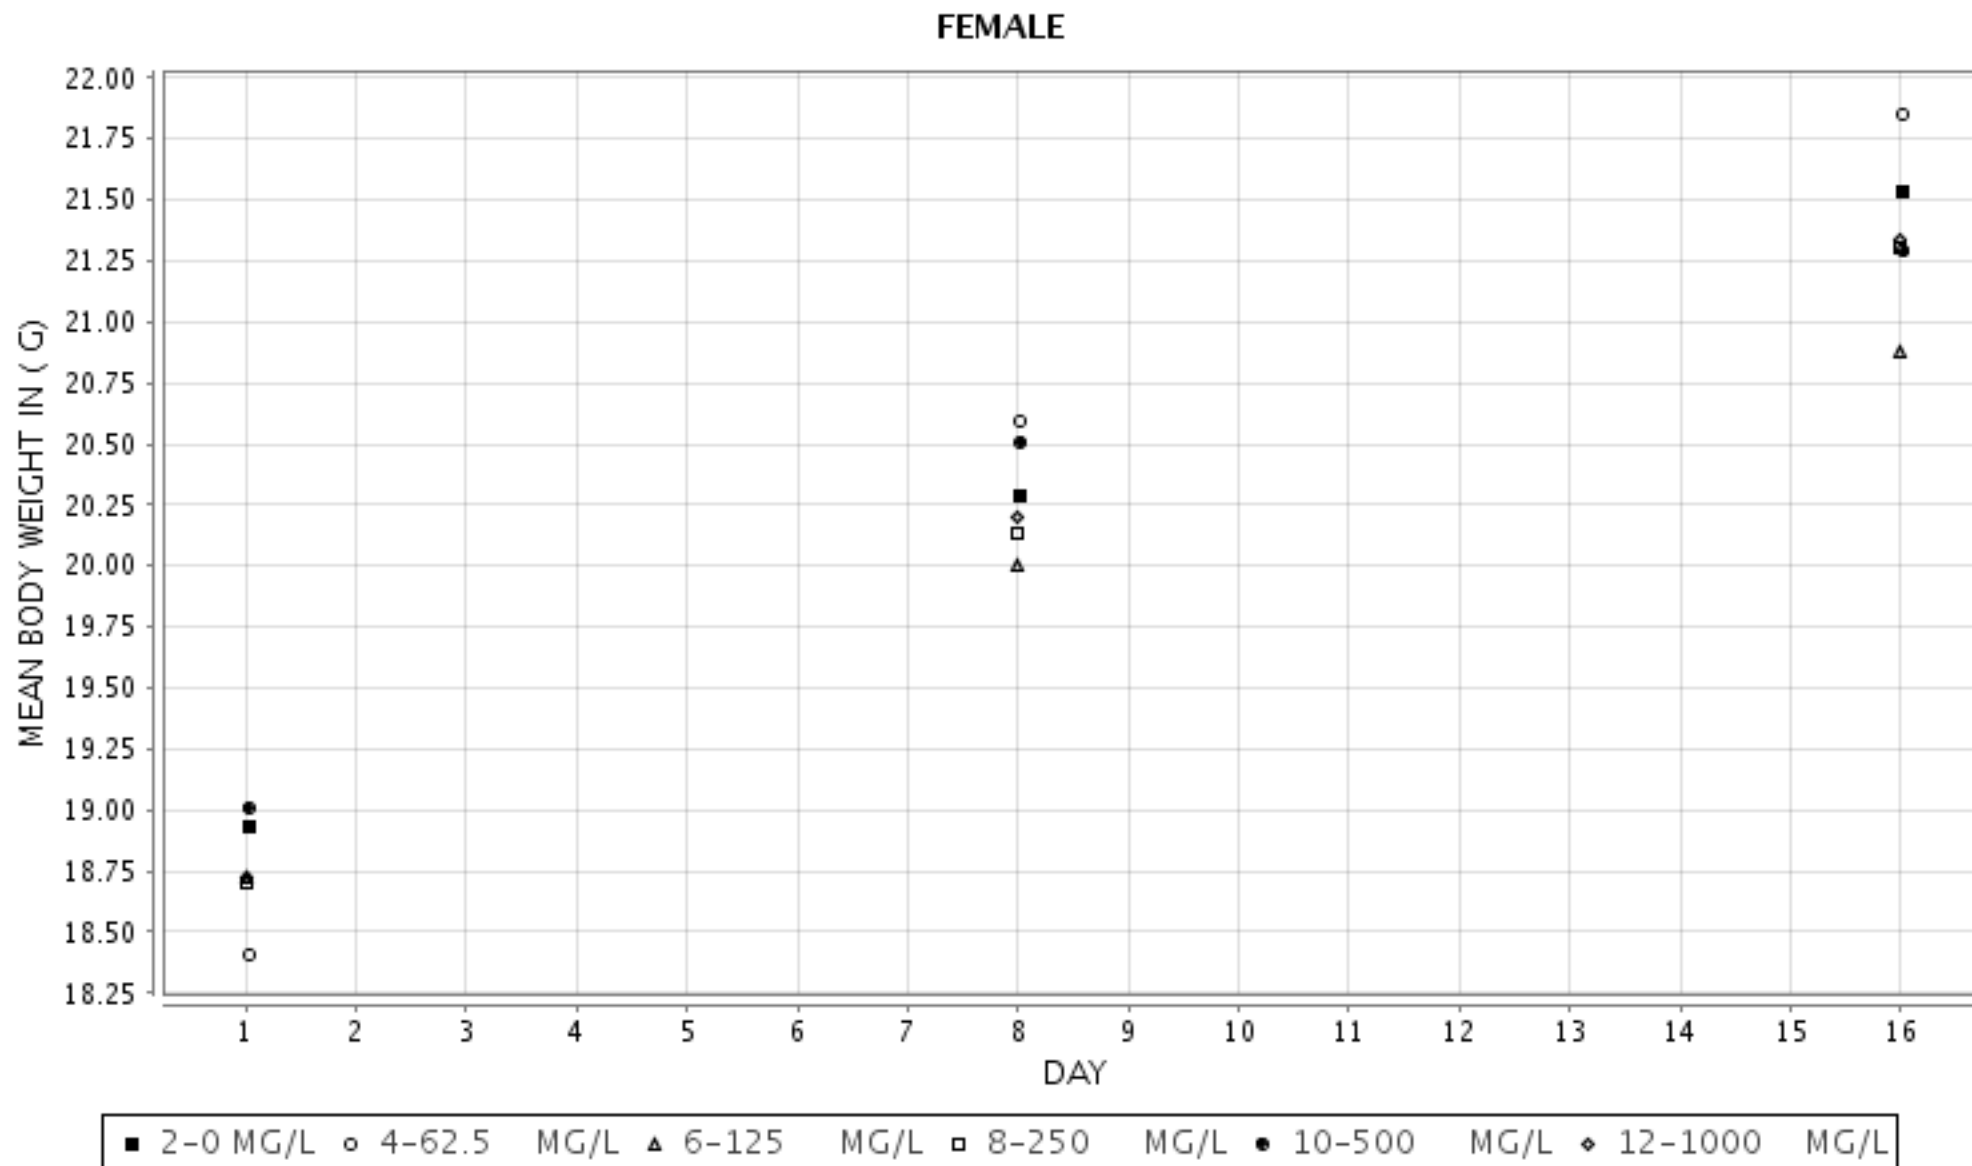

Experiment Number: 96014-02

Test Type: 14-DAY

Species/Strain: Mouse/B6C3F1

E03: TDMS CAMERA-READY GROWTH CURVE

Test Compound: Water disinfection byproducts (Bromodichloroacetic acid)

CAS Number: 71133-14-7

Date Report Requested: 10/22/2014

Time Report Requested: 05:07:39

First Dose M/F: NA / NA

Lab: SRI

**** END OF REPORT ****