

**Experiment Number:** 97013-12  
**Test Type:** 14-DAY  
**Route:** SKIN APPLICATION  
**Species/Strain:** Mouse/FVB/N

**E03: TDMS CAMERA-READY GROWTH CURVE**  
**Test Compound:** Water disinfection model (Dichloroacetic acid)  
**CAS Number:** 79-43-6

**Date Report Requested:** 10/23/2014  
**Time Report Requested:** 03:19:45  
**First Dose M/F:** NA / NA  
**Lab:** BAT

<b>C Number:</b>	C97013D
<b>Lock Date:</b>	Not Entered.
<b>Cage Range:</b>	All
<b>Date Range:</b>	All
<b>Reasons For Removal:</b>	All
<b>Removal Date Range:</b>	All
<b>Treatment Groups:</b>	All
<b>Study Gender:</b>	Both
<b>PWG Approval Date</b>	NONE

Experiment Number: 97013-12

Test Type: 14-DAY

Route: SKIN APPLICATION

Species/Strain: Mouse/FVB/N

**E03: TDMS CAMERA-READY GROWTH CURVE**  
Test Compound: Water disinfection model (Dichloroacetic acid)  
CAS Number: 79-43-6


Date Report Requested: 10/23/2014

Time Report Requested: 03:19:45

First Dose M/F: NA / NA

Lab: BAT

### MALE

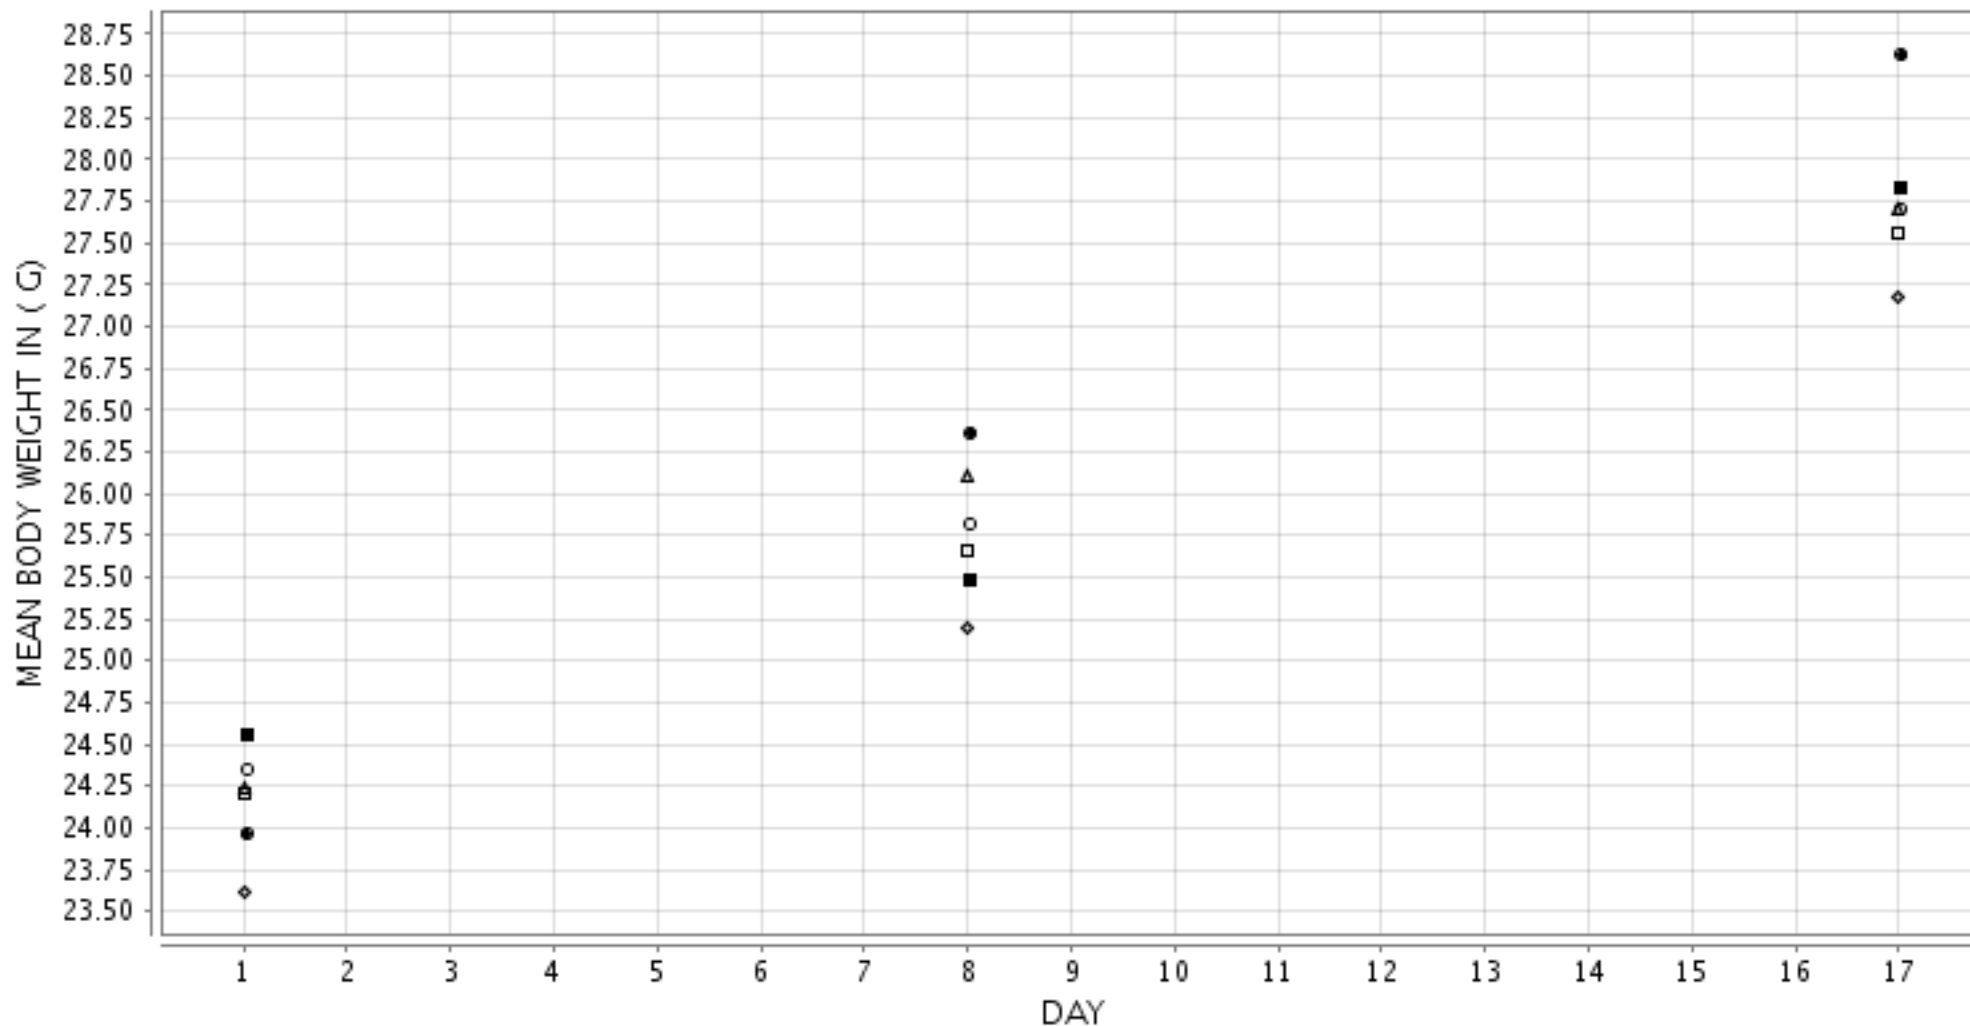

■ 1-0 MG/KG   ○ 3-31.25 MG/KG   ▲ 5-62.5 MG/KG   □ 7-125 MG/KG   ● 9-250 MG/KG   ◆ 11-500 MG/KG

**Experiment Number:** 97013-12

**Test Type:** 14-DAY

**Route:** SKIN APPLICATION

**Species/Strain:** Mouse/FVB/N

**E03: TDMS CAMERA-READY GROWTH CURVE**

**Test Compound:** Water disinfection model (Dichloroacetic acid)

**CAS Number:** 79-43-6

**Date Report Requested:** 10/23/2014

**Time Report Requested:** 03:19:45

**First Dose M/F:** NA / NA

**Lab:** BAT

\*\*\*END OF MALE DATA\*\*\*

Experiment Number: 97013-12

Test Type: 14-DAY

Route: SKIN APPLICATION

Species/Strain: Mouse/FVB/N

E03: TDMS CAMERA-READY GROWTH CURVE  
Test Compound: Water disinfection model (Dichloroacetic acid)  
CAS Number: 79-43-6


Date Report Requested: 10/23/2014

Time Report Requested: 03:19:45

First Dose M/F: NA / NA

Lab: BAT

### FEMALE

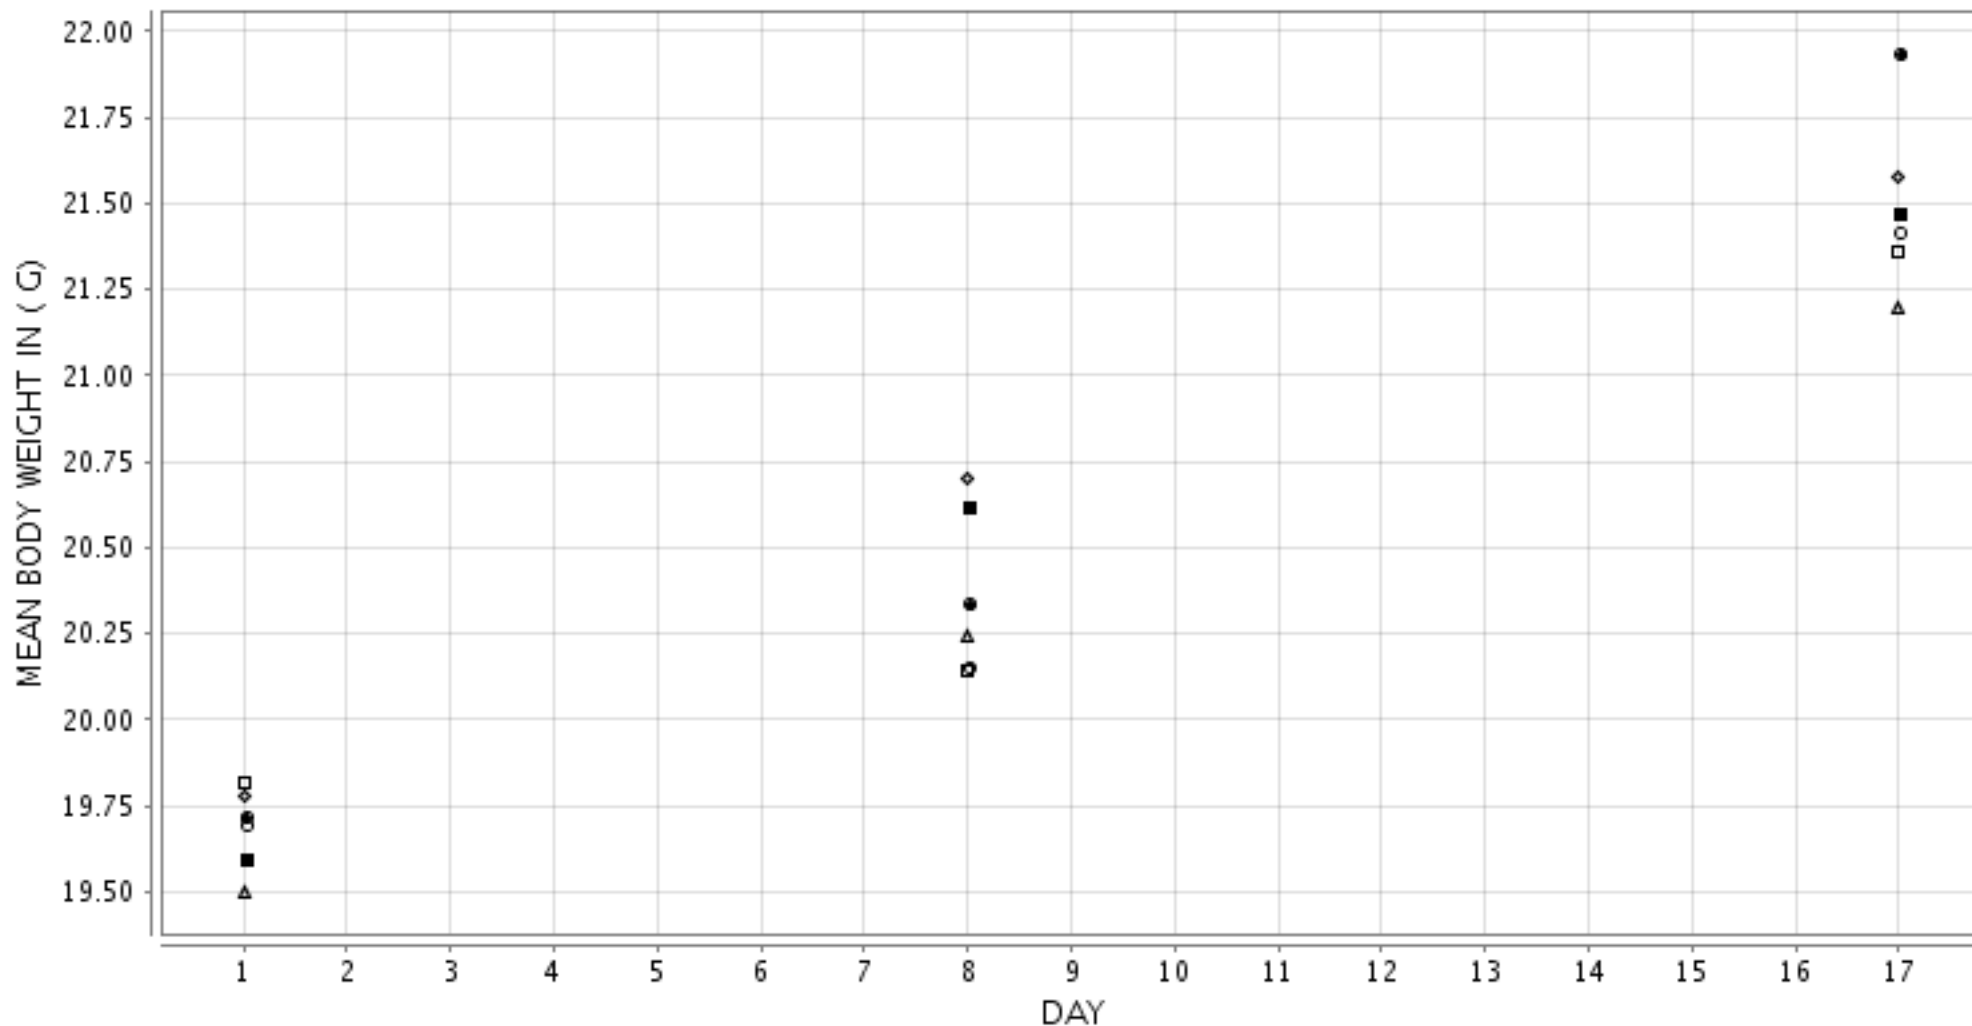

■ 2-0 MG/KG   ○ 4-31.25 MG/KG   ▲ 6-62.5 MG/KG   □ 8-125 MG/KG   ● 10-250 MG/KG   ◇ 12-500 MG/KG

**Experiment Number:** 97013-12

**Test Type:** 14-DAY

**Route:** SKIN APPLICATION

**Species/Strain:** Mouse/FVB/N

**E03: TDMS CAMERA-READY GROWTH CURVE**

**Test Compound:** Water disinfection model (Dichloroacetic acid)

**CAS Number:** 79-43-6

**Date Report Requested:** 10/23/2014

**Time Report Requested:** 03:19:45

**First Dose M/F:** NA / NA

**Lab:** BAT

**\*\* END OF REPORT \*\***